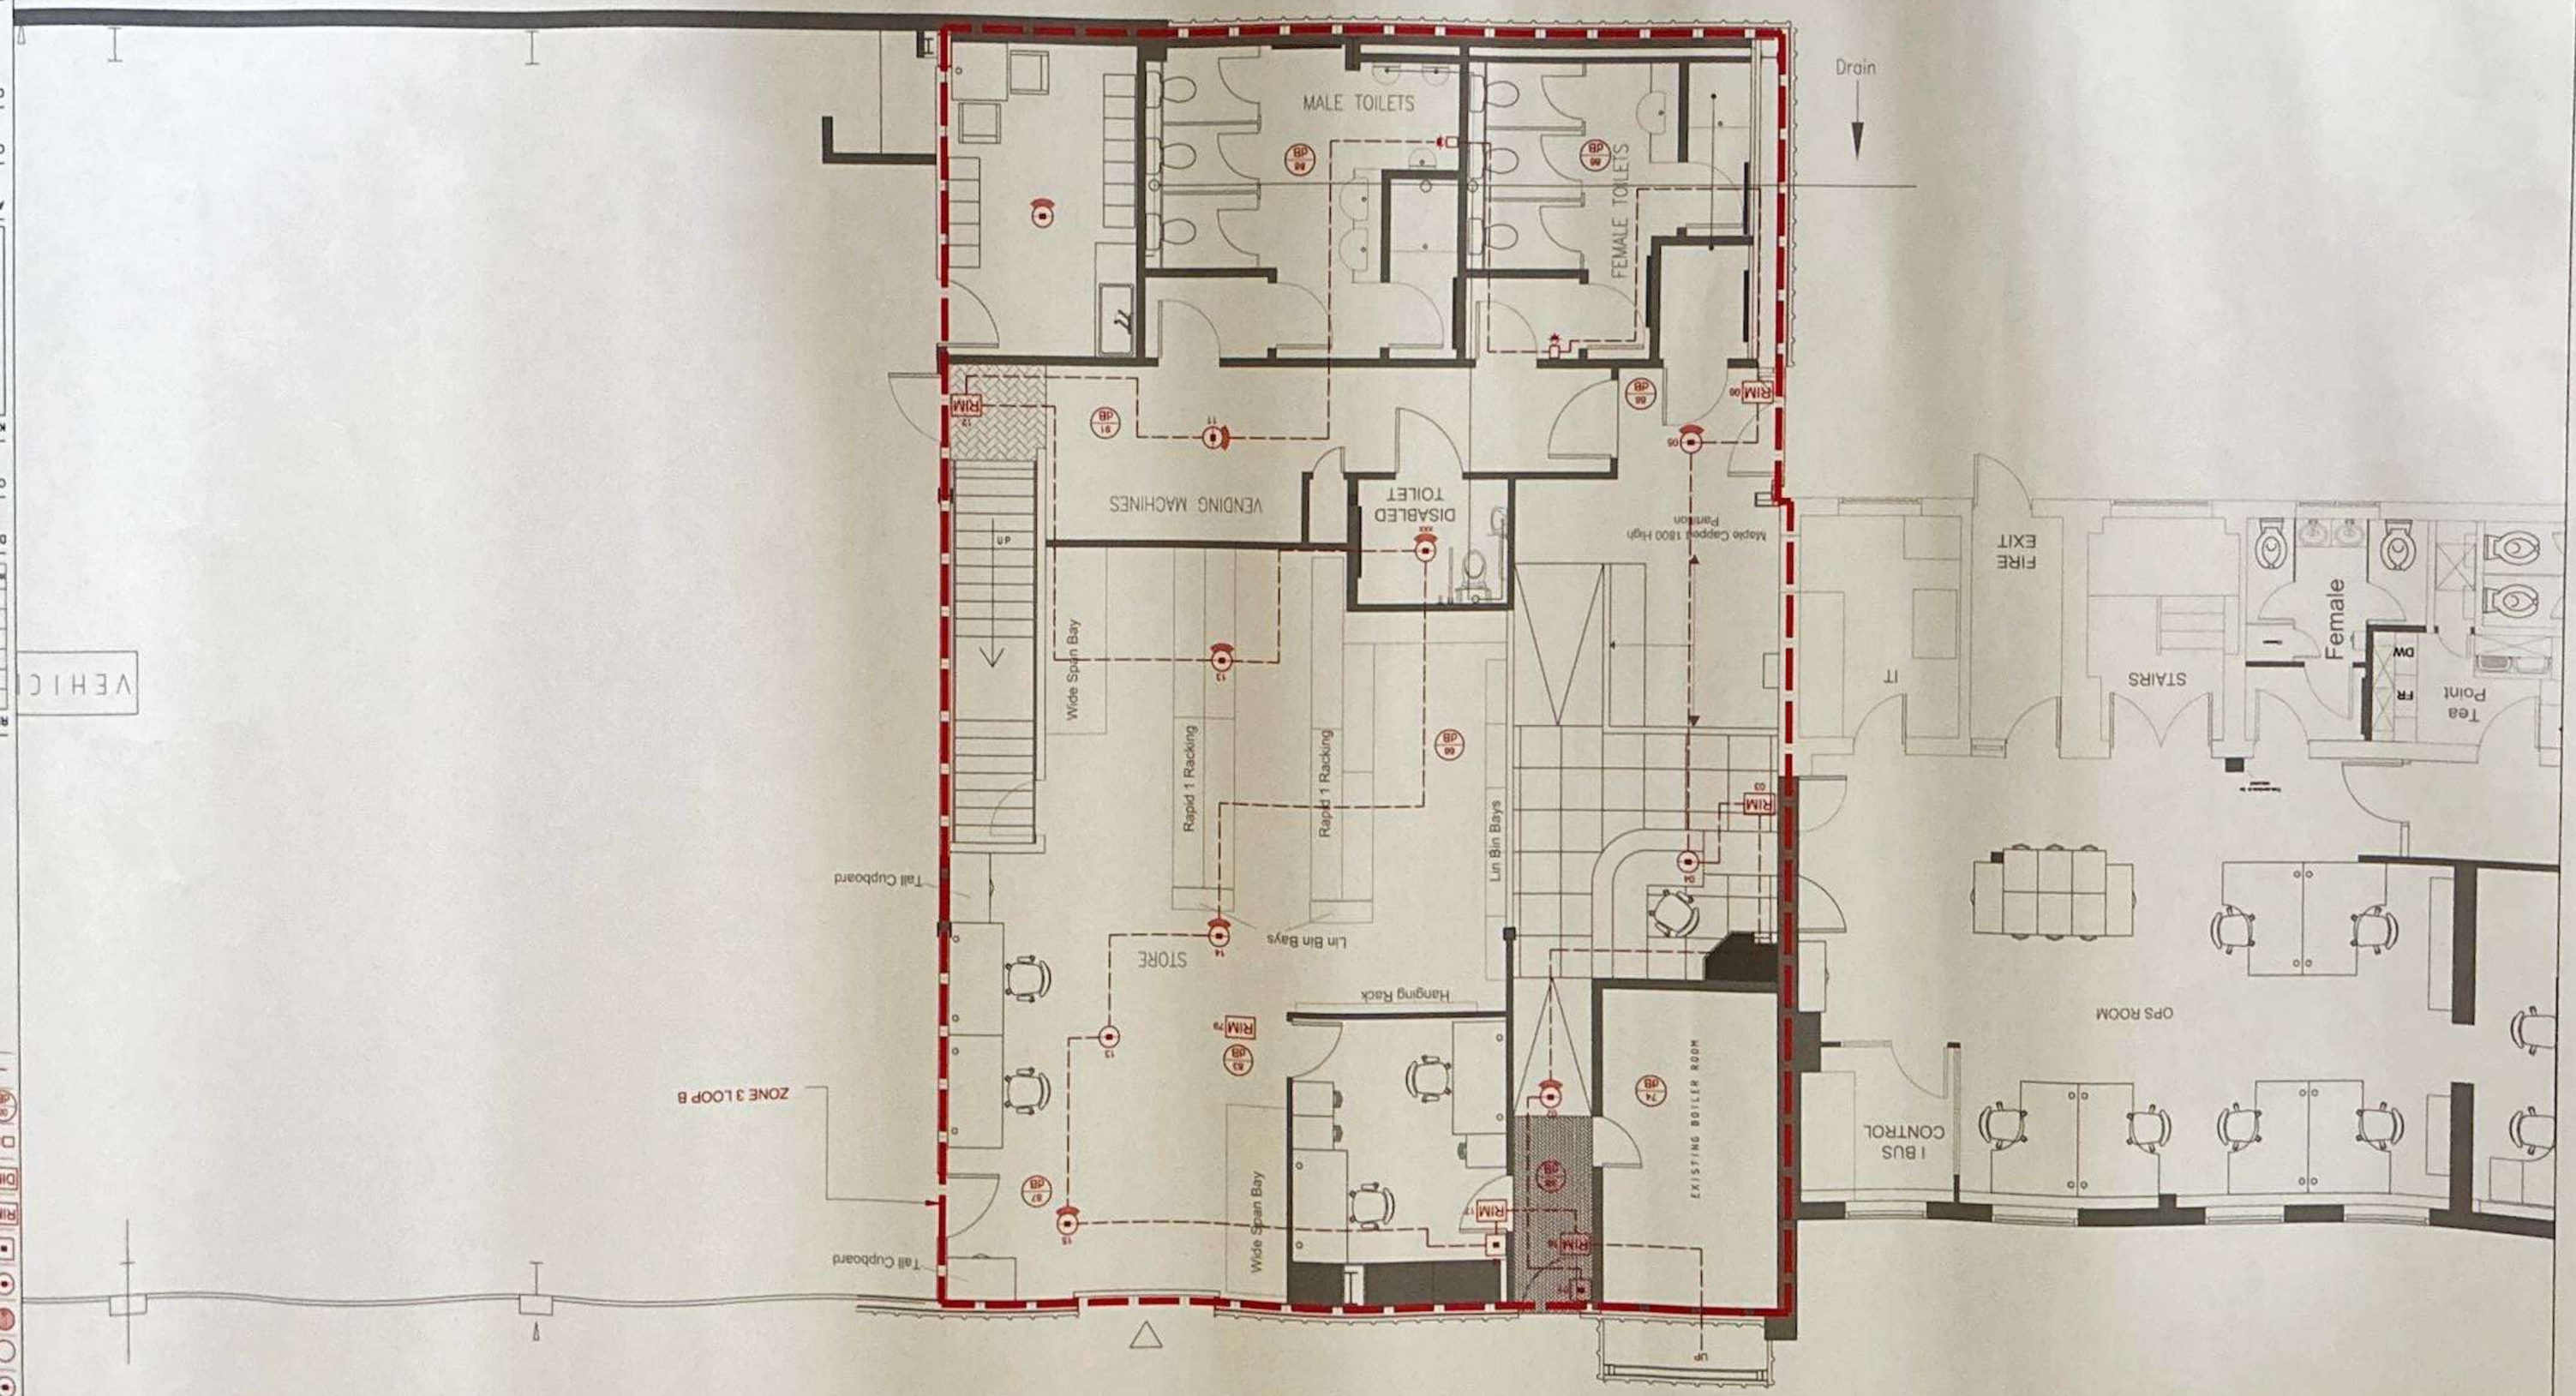

NOTES

- DO NOT SCALE FROM THIS DRAWING
- ALL DIMENSIONS IN MILLIMETRES, EXCEPT IF STATED OTHERWISE.
- SITE VERIFY ALL DIMENSIONS PRIOR TO INSTALLATION
- REPORT ALL DISCREPANCIES TO THE DRAWING ORIGINATOR IMMEDIATELY
- THIS DRAWING IS TO BE READ IN CONJUNCTION WITH ALL RELEVANT DOCUMENTS AND PARTY WALL AWARDS.
- CABLE AND ALL WIRING LAYOUTS ARE INDICATIVE. NO DO NOT REPRESENT THE TO BE INSTALLED. CABLE RUN UNLESS OTHERWISE STATED.
- ALL DESIGN RESPONSIBILITY SHALL FALL ON EITHER THE ADT SALESPERSON, ALONG WITH THE PERSONS WHO HAVE DESIGN AND APPROVED THE DRAWING.

LEGEND:

- MULTI SENSOR HEAT AND SMOKE DETECTOR (601FH)
- LOOP POWERED SOUNDER BASE (602SB)
- HEAT DETECTOR (601H)
- DUCT PROB DETECTOR.
- CALL POINT (CP620).
- RELAY INTERFACE MODULE (RM400).
- DETECTOR INTERFACE MODULE (DIM400).
- SIRPHONE / BEACON.
- DECIBELS HEADINGS.
- WIRING ROUTES FP200 1 3AM 2 CORE

REV	DESCRIPTION OF CHANGES	DATE	DRAWN BY
A	ISSUED FOR APPROVAL	07.05.09	A. ABBE
B	ADDED LAYOUT AL RADIO. DS SECTIONS. MARK. RE MIC 600MHZ ADDED. ISSUED FOR APPROVAL	25.06.15	A. ABBE

REVISION HISTORY:

DRAWING STATUS: APPROVED

CLIENT: EPSOM COACHES

KEYPLAN:

ADT SALESPERSON: MARK SMITH

CLIENT ORIGINAL REFERENCE LAYOUT DRAWING: 5491 RD-01

CLIENT ADDRESS: EPSOM COACHES GROUP, 21 BLENHEIM ROAD, EPSOM SURREY

DRAWING TITLE: FIRE ALARM LAYOUT, STAFF & STORES AREAS, GROUND FLOOR PLAN

ADT Fire & Security

DRAWN BY:	CHECKED BY:	APPROVED BY:
A. ABBE	N/A	N/A
DATE:	SCALE:	DATE:
07.05.09	1:50 @ A1	N/A

ADT DWG No.

SET No.	TYPE	DWG No.	REV
0200	B	161	A 02

ADT Fire & Security PLC

THIS DRAWING IS THE COPYRIGHT OF ADT FIRE & SECURITY PLC AND MAY NOT BE REPRODUCED OR COPIED IN WHOLE OR IN PART WITHOUT THE WRITTEN CONSENT OF ADT FIRE & SECURITY PLC. ANY UNAUTHORISED REPRODUCTION, COPYING OR USE OF THIS DRAWING MAY LEAD TO LEGAL ACTION BEING TAKEN AGAINST THE INFRINGING PARTY.